

# Process Analysis Systems

Chem	Energy	Pharm	Food	Water
------	--------	-------	------	-------

## Protos® 3400 (X)

### Specifications OXY 3400 (X)-066 module

Oxy input**) (Ex ia IIC)	for sensor models SE 707, InPro 6900 (i) (Mettler Toledo), OXYGOLD (Hamilton), and others control and evaluation of ISM sensors
Measuring range	meas. current 0 ... 600 nA, resolution 10 pA
Measurement error	< 0.5 % meas. val. + 0.05 nA + 0.005 nA/K
Saturation (-10 ... +80 °C)	0.0 ... 199.9/200 ... 600 % air 0.0 ... 29.9/30 ... 120 % O <sub>2</sub>
Concentration (-10 ... +80 °C)	0000 ... 9999 µg/l (overrange up to 19.99 mg/l) 0000 ... 9999 ppb (overrange up to 19.99 ppm) 0.00 ... 200.00 mg/l 0.00 ... 200.00 ppm
Volume concentration in gas	0000 ... 9999 ppm/0.0 ... 120 %
Partial pressure	0 ... 5000 mbars
Pressure correction	air pressure 700 ... 1100 mbars manual correction 0 ... 9999 mbars externally via current input 0 ... 9999 mbars
Salinity correction	0.0 ... 45.0 g/kg
Polarization voltage	0 ... -1000 mV, default -675 mV (resolution 5 mV)
Permissible guard current	≤ 20 µA
ISM	Intelligent Sensor Management display of sensor data: manufacturer, serial number, calibration record, load matrix, sensor wear, ...
Sensoface®	provides information on the sensor condition: zero/slope, response time, calibration timer, Sensocheck®, sensor wear
Sensor network diagram	graphical representation of current sensor parameters in a network diagram on the display: slope, zero point, response time, calibration timer, Sensocheck®
Sensor monitoring*)	Sensocheck® (not for sensors with guard) monitoring of membrane and electrolyte
Sensor monitor	direct display of measured values from sensor for validation: sensor current/barometric pressure/temperature
Sensor standardization*)	operating modes: – automatic calibration in air – automatic calibration in air-saturated water – product calibration for saturation – product calibration for concentration – data entry of zero slope – zero calibration – adoption of calibration data from digital sensors
Calibration record/statistics	recording of: zero, slope, response time, calibration method with date and time of the last three calibrations and the first calibration
Output curve*)	– linear – trilinear – function – as desired via table

**Specifications** OXY 3400 (X)-066 module – continued

Temperature input**)	temperature detector: NTC 22 kohms/NTC 30 kohms 2-wire connection, adjustable
Measuring range	-20 ... +150 °C/-4 ... +302 °F
Resolution	0.1 °C
Measurement error <sup>1) 2) 3)</sup>	0.2 % meas. val. + 0.5 K (< 1 K with T > 100 °C)
Current input (Ex ia IIC)	for pressure transmitter
Pressure range	0 ... 9999 mbars
Current range	0(4) ... 20 mA/50 ohms start/end user-defined within pressure range
Resolution	< 1 %
Explosion protection	IECEX: Ex ib [ia] IIC T4 ATEX: II 2 (1) G Ex ib [ia] IIC T4 FM: IS, Class 1, Div 1, GRP A, B, C, D, T4, Entity Class I, Zone 1, A Ex ib [ia], GRP IIC, T4 CSA: NI, Class I, Div 2, GRP A, B, C, D, with IS circuits extending into Div 1 AIS, Class I, Zone 1, Ex ib [ia] IIC T4 NI, Class I, Zone 2, Ex nA [ia] IIC GOST: 1 Ex ib [ia] IIC T4 NEPSI: Ex ib [ia] IIC T4
EMC	NAMUR NE 21 and EN 61326
Emitted interference	Class B
Immunity to interference	Industry
Lightning protection	EN 61000-4-5, Installation Class 2
Nominal operating conditions	ambient temperature: -20 ... +55 °C (Ex: max. 50 °C) relative humidity: 10 ... 95 % not condensing
Transport/Storage temperature	-20 ... +70 °C
Module enclosure	material: PC/ABS blend
Color	black
Protection	IP 20
Dimensions (mm)	w x h x d: 118 x 91 x 21
Terminals	screw clamp connection, single wires and flexible leads up to 2.5 mm <sup>2</sup>

\*<sup>1)</sup> user-defined

<sup>2)</sup> to IEC 746 Part 1, at nominal operating conditions

<sup>3)</sup> ±1 count

<sup>3)</sup> plus sensor error


<sup>\*\*</sup> Oxy input, temperature input galvanically connected, galvanically isolated up to 60 V against the other inputs, outputs, relay contacts (protective separation due to double insulation in accordance with EN 61010-1).

# Process Analysis Systems

**Chem** | **Energy** | **Pharm** | **Food** | **Water**

## Protos® 3400 (X)

**Terminal Assignments OXY 3400 (X)-066 module**

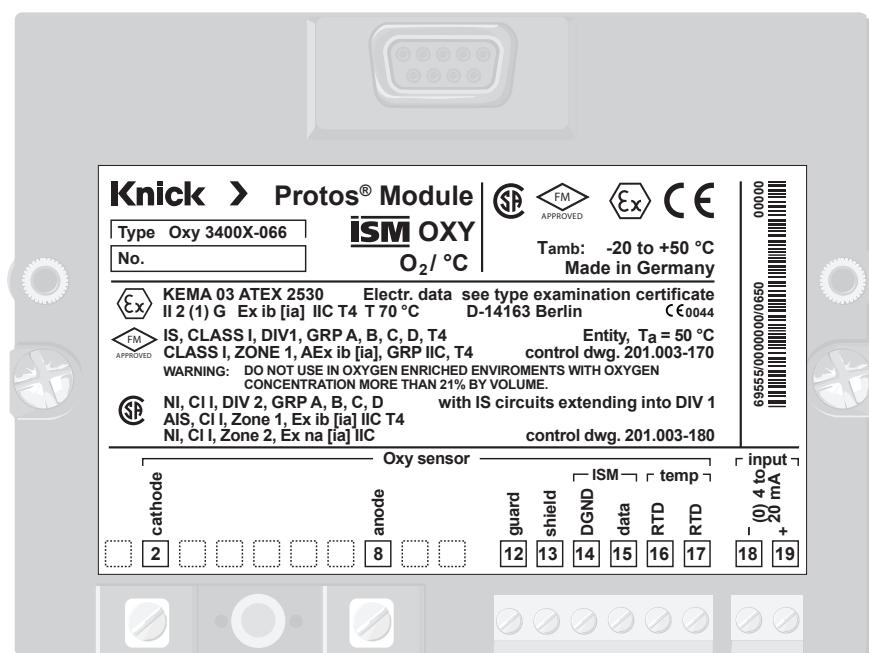

For up-to-date information, please visit [www.knick.de](http://www.knick.de)

